



Uponor

PRE-INSULATED
PIPE SYSTEMS
WIPLEX™ FITTINGS

INSTRUCTION SHEET

Uponor WIPLEX™ Fittings Instruction Sheet

Introduction

Uponor's WIPLEX™ fittings are manufactured from a dezincification-resistant alloy, DZR brass, and are specifically designed for connecting 1" to 4" Uponor PEX tubing within the Ecoflex® pre-insulated pipe system. The unique design of the WIPLEX fitting features an eccentric outer sleeve for easier grip and an even force when inserting the tubing. The inner sleeve features a threaded profile and includes an o-ring to ensure a secure, tight seal (see **Figure 1**). The maximum operating pressure and temperature for WIPLEX fittings is 87 psi at 203°F.

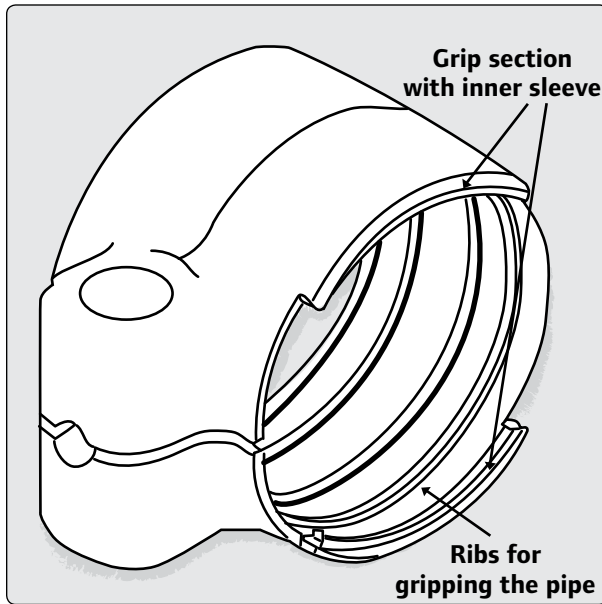


Figure 1: Eccentric Design of the WIPLEX Fitting

Getting Started

Check the contents of this package. For damaged or missing contents, please contact your Uponor sales representative or distributor for assistance.

The package includes:

- WIPLEX Fitting(s)
- O-ring(s)
- Bolts, washers and nuts
- WIPLEX Fittings Instruction Sheet

Tools and Parts Required

- Plastic tube cutter
- Low-friction lubrication (MoS2)
- De-burring tool or knife
- Wrench (See **Table 1** for sizes)

Part No.	Part Description	Wrench Size
5550010	PEX 1" x NPT 1"	FD 2 – 10mm
5550013	PEX 1¼" x NPT 1¼"	FD 2 – 10mm
5550015	PEX 1½" x NPT 1½"	FD 2 – 13mm
5550020	PEX 2" x NPT 2"	FD 2 – 13mm
5550025	PEX 2½" x NPT 2"	FD 2 – 17mm
5550030	PEX 3" x NPT 2½"	FD 2 – 19mm
5550035	PEX 3½" x NPT 3"	FD 2 – 24mm
5550040	PEX 4" x NPT 4"	FD 2 – 24mm

Table 1: Wrench Sizes for Tubing

Installation



Important: Read this instruction sheet completely before beginning installation. If you have any questions about these instructions, please contact your Uponor sales representative or distributor for assistance.

1. Cut the tubing with an appropriate plastic-pipe cutter. If using another method for cutting the tubing, ensure the shavings inside the tube are removed prior to installing the fitting to avoid blocking valves.



Figure 2: Cut the Tubing

2. Chamfer the tubing bore with a de-burring tool or knife, and remove any external burrs. This prevents the o-ring from damage or from being dislodged from its groove during installation.



Figure 3: Chamfer the Tubing

3. Use a suitable pair of pliers to dismount the outer sleeve. (See **Figure 5** for an example of suitable pliers.)



Figure 4: Dismounting Outer Sleeve

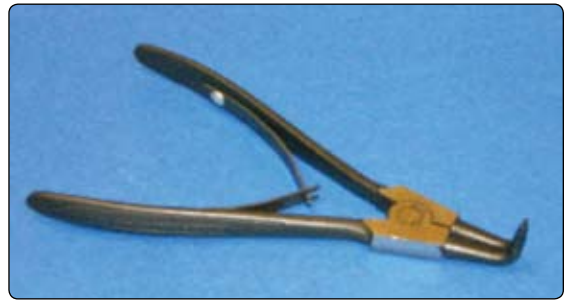


Figure 5: Example of Suitable Pliers

4. Place a bolt head between the pads, and remove the outer sleeve.



Figure 6: Insert Bolt Head

5. Mount the outer sleeve onto the tubing. Make sure to position the outer sleeve correctly towards the inner sleeve, so the locking grooves engage.

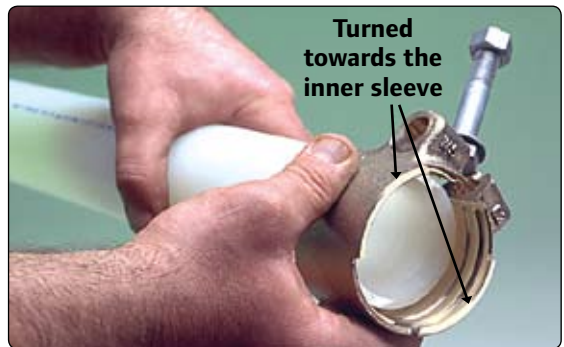


Figure 7: Mount the Outer Sleeve

6. To ensure easy mounting of the pipe onto the inner sleeve, lubricate the o-ring, preferably with an environmentally friendly silicone spray or soap.

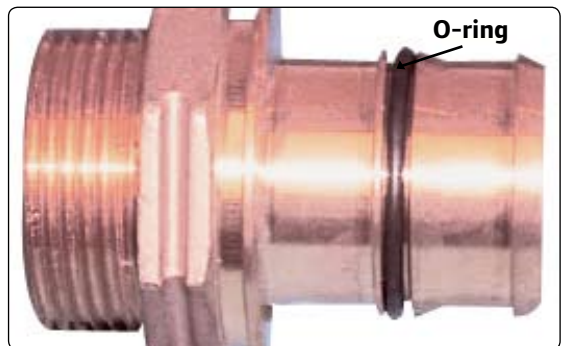


Figure 8: Lubricate the O-ring

7. Mount the pipe on the insert sleeve and push the outer sleeve until it reaches the stop support for the tubing.

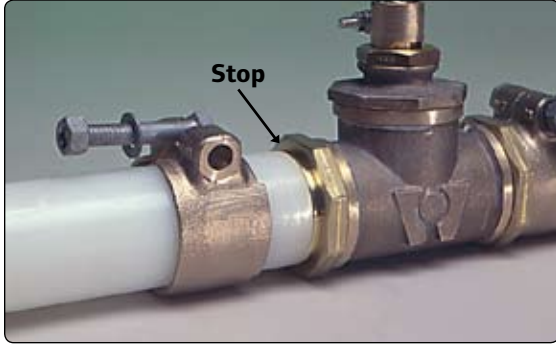


Figure 9: Push Outer Sleeve to Stop Support



Important: Lubricate the bolt threads and washer with suitable low-friction lubrication (MoS₂) before tightening.

8. Tighten the WIPEX fitting.

Note: Tighten slowly by hand to avoid thread problems when assembling acid-resistant, stainless-steel bolts in a screw joint. If using a tightening machine, only use a low number of revolutions.

Use open-ended or ring spanners and slowly tighten until the pads of the clamping sleeve are in contact with one another (see **Figure 10**).

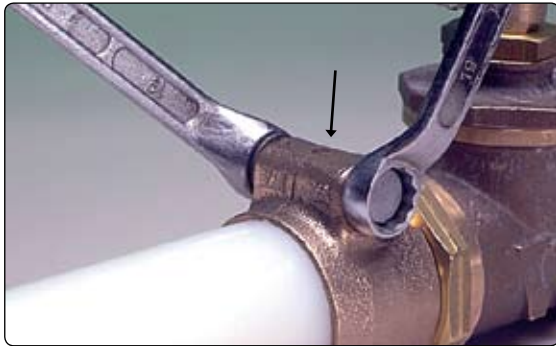


Figure 10: Tighten the Fitting



Caution: If the pads do not come in contact, wait 30 minutes and then try tightening again until the pads are in contact with one another (see **Figure 11**).


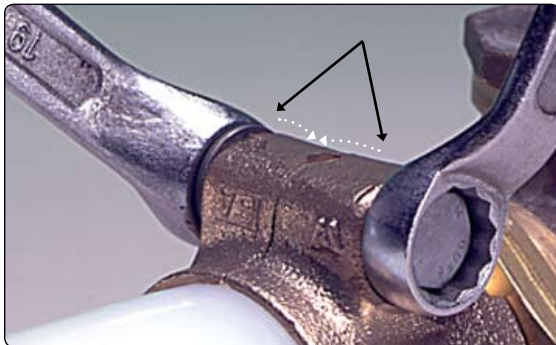


Figure 11: Grip and Seal Between Fitting and Pipe

9. Perform pressure testing according to current standards. If standards are not available, refer to the following instructions:

- Vent all air from the system and apply one-and-a-half times the normal operating pressure.
- Maintain this pressure for 30 minutes, and visually inspect the joints.
- Quickly drain off water until the pressure falls to one-half the normal operating pressure, and close the drain valve.
- If the pressure rises to a constant level higher than one-half the normal operating pressure, the system is tight.
- Maintain this pressure for 90 minutes, and visually inspect the fittings during this time. A drop in pressure indicates a leak in the system.

Specifications

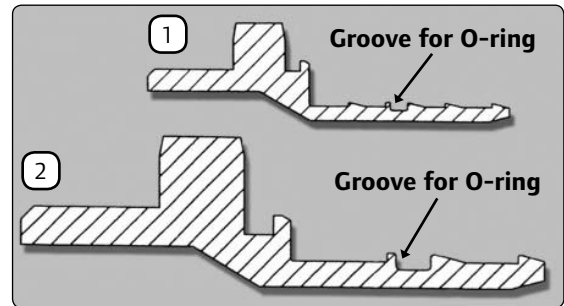

Style	Profile Dimensions	Pressure Class
1	2½" to 4"	87 psi at 203°F
2	1" to 2"	87 psi at 203°F

Uponor, Inc.
5925 148th Street West
Apple Valley, MN 55124 USA
Tel: (800) 321-4739
Fax: (952) 891-2008
Web: www.uponor-usa.com

Uponor Ltd.
2000 Argentia Rd., Plaza 1, Ste. 200
Mississauga, ON L5N 1W1 CANADA
Tel: (888) 994-7726
Fax: (800) 638-9517
Web: www.uponor.ca

uponor